

## REFERENCES

- American Public Health Association (APHA) 2004. Standard methods for the examination of water and wastewater, 20<sup>th</sup> ed. Washington D.C.: APHA.
- Andersen, H. R.; Hansen, M.; Kjolholt, J.; Stuer-Lauriden, F.; Tenes, T., Halling-Sorensen, B. 2005. Assessment of the importance of sorption for steroid estrogens removal during activated sludge treatment. Chemosphere 61: 139-146.
- Barnard, J. L. 1984. Activated primary tanks for phosphorus removal. Water SA 10: 3.
- Belfroid, A. C.; Van Der Horst, A.; Vethaak, A. D.; Schafer, A. J.; Rijs, G. B. J.; Wegener, J.; and Cofino, W. P. 1999. Analysis of occurrence of estrogenic hormones and their glucuronides in surface water and wastewater in the Netherlands. Science of Total Environment 225: 101-108
- Broughton, A.; Pratt, S.; and Shilton, A. 2008. Enhanced biological phosphorus removal for high-strength wastewater with a low rbCOD:P ratio. Bioresource Technology 99: 1236-1241.
- Choi, Y. S.; Shin, E. B.; and Lee, Y. D. 1996, Biological phosphorus removal from wastewater in a single reactor combining anaerobic and aerobic conditions. Water Science and Technology 34: 179-186.
- Clara, M.; Strenn, B.; Saracevic, E.; and Kreuzinger, N. 2004. Adsorption of bisphenol-A, 17 $\beta$ -estradiol and 17 $\alpha$ -ethinylestradiol to sewage sludge. Chemosphere 56: 843-851.
- Converti, A.; Rovatti, M.; and Borghi, M. 1995. Biological removal of phosphorus from wastewaters by alternating aerobic and anaerobic conditions. Water Research 29: 263-269.
- Chui, P. C.; Terashima, Y.; Tay, J. H.; and Ozaki, H. 1996. Performance of a partly aerated biofilter in the removal of nitrogen. Water Science and Technology 34: 187-194.
- Danish Environmental Protection Agency (DEPA) 2004. Degradation of estrogens in sewage treatment processes. Danish: DEPA.

- Desbrow, C.; Routledge, E. J.; Brighty, G. C.; Sumpter, J. P.; and Waldock, M. 1998. Identification of estrogenic chemicals in STW effluent I. chemical fractionation and in vitro biological screening. Environmental Science and Technology 32: 1549-1558.
- Desmes, T. Z. D.; Kujawa-Roeleveld, K.; Zeeman, G.; and Lettinga, G. 2008. Anaerobic biodegradation of estrogens-hard to digest. Water Science and Technology 57: 1177-1182.
- Dytczak, M. A.; Londry, K. L.; and Oleszkiewicz, J. A. 2008. Biotransformation of estrogens in nitrifying activated sludge under aerobic and alternating anoxic/aerobic conditions. Water Environmental Research 80: 47-52.
- Flemming, L. and Bent, H. 2003. Evaluation of analytical chemical methods for detection of estrogens in the environment. Danish: DEPA.
- Fuhs, G. W. and Chen, M. 1975. Microbiological basis of phosphate removal in the activated sludge. Microbiology Ecology 2: 119-138.
- Furuichi, T.; Kannan, K.; Suzuki, K.; Tanaka, S.; Giesy, J. P.; and Masunaga, S. 2006. Occurrence of estrogenic compounds and removal by a swine farm waste treatment plant. Environmental Science and Technology 40: 7896-7902.
- Goncalves, R. F. and Rogalla, F. 1992. Continuous biological phosphorus removal in biofilm reactor. Water Science and Technology 26: 2027-2030.
- Hanselman, T. A.; Graetz, D. A.; and Wilkie, A. C. 2003. Review of manure-borne estrogens as potential environmental contaminants: a review. Environmental Science and Technology 33: 5471-5478.
- Hu, Z.; Wentzel, M. C.; and Ekama, G. A. 2002. Anoxic growth of phosphate accumulating organisms (PAOs) in biological nutrient removal activated sludge systems. Water Research 36: 4927-4937.
- Johnson, A. C.; Sumpter, J. P.; and Dicorcia, A. 2000. Estimating steroid oestrogen inputs into activated sludge treatment works and observations on their removal from the effluent. Science of Total Environment 256: 163-173.

- Joss, A.; Andersen, H.; Ternes, T.; Richle, P. R.; and Siegrist, H. 2004. Removal of estrogens in municipal wastewater treatment under aerobic and anaerobic conditions: consequences for plant optimization. Environmental Science and Technology 38: 3047-3055.
- Khanal, S. K.; Xie, B.; Thompson, M. L.; Sung, S.; Ong, S. K.; and Leeuwen, J. H. V. 2006. Fate, transport, and biodegradation of natural estrogens in the environment and engineered systems. Environmental Science and Technology 40: 6537-6546.
- Kikuta, T. and Urase, T. 2003. Removal of endocrine disruptors in membrane separation activated sludge process. Proceedings of International Membrane Science and Technology Conference, Australia.
- Lai, K. M.; Scrimshaw, K. M.; and Lester, J. N. 2000. Binding of waterborne steroid estrogens to solid phases in river and estuarine systems. Environmental Science and Technology 34: 3890-3894.
- Lee, H. B. and Liu, D. 2002. Degradation of 17 $\beta$ -estradiol and its metabolites by sewage bacteria. Water, Air, and Soil Pollution 134: 353-368.
- Jobling, S.; Sheaham, D. A.; Osborne, J. A.; Matthiessen, P.; and Sumpter, J. P. 1998. Widespread sexual disruption in wild fish. Environmental Science and Technology 32: 2498-2506.
- Metcalf and Eddy. 2003. Wastewater engineering: treatment and reuse. 4<sup>th</sup> ed. New York: McGraw-Hill.
- Mino, T.; Van Loosdrecht, M. C. M.; and Heijnen, J. J. 1998. Microbiology and biochemistry of the enhanced biological phosphate removal process. Water Research 32: 3193-3207.
- Pak, D. and Chang, W. 2000. Factors affecting phosphorus removal in two biofilter system treating wastewater from car-washing facility. Water Science and Technology 41: 487-492.
- Quintana, J. B.; Carpinteiro, J.; Rodriguez, I.; Lorenzo, R. A.; Carro, A. M.; and Cela, R. 2004. Determination of natural and synthetic estrogens in water by gas chromatography with mass spectrometric detection. Journal of Chromatography 1024: 177-185.
- Randall, C. W.; Barnard, J. L.; and Stensel, H. D. 1992. Design and retrofit of wastewater treatment plants for biological nutrient removal. Chicago: Technomic.

- Ren, Y. X.; Nakano, K.; Nomura, M.; Chiba, N.; and Nishimura, O. A. 2007. Thermodynamic analysis on adsorption of estrogens in activated sludge process. Water Research 41: 2341-2348.
- Routledge, E. J.; Sheahan, D.; Desbrow, C.; Brighty, G. C.; Waldock, M.; and Sumpter, J. P. 1998. Identification of estrogenic chemicals in STW effluent 2. in vivo responses in Trout and Roach. Environmental Science and Technology 32: 1559-1565.
- Sedlak, R. I. 1991. Phosphorus and nitrogen removal from municipal wastewater. 2<sup>nd</sup> ed. New York: Lewis Publishers.
- Shanableh, A.; Abeysinghe, D.; and Hijazp, A. 1997. Effect of cycle duration on phosphorus and nitrogen transformations in biofilters. Water Research 31: 149-153.
- Sharpe, R. M. and Skakkebaek, N. E. 1993. Are estrogens involved in falling sperm counts and disorders of the male reproductive-tract. LANCET 341: 1392-1395.
- Shore, L. S.; Correll, D. L.; Chakraborty, P. K. 1995. Relationship of fertilization with chicken manure and concentration of estrogens in small streams. Florida: Lewis Publishers.
- Sommariva, C.; Converti, A.; and Borghi, D. M. 1997. Increase in phosphate removal from wastewater by alternating aerobic and anaerobic conditions. Desalination 108: 255-260.
- Shi, J.; Fujisawa, S.; Nakai, S.; and Hosomi, M. 2004. Biodegradation of natural and synthetic estrogens by nitrifying activated sludge and ammonia-oxidizing bacterium *Nitrosomonas europaea*. Water Research 38: 2323-2330.
- Tay, J. H.; Chui, P. C.; and Li, H. 2003. Influence of COD:N:P ratio on nitrogen and phosphorus removal in fixed-bed filter. Journal of Environmental Engineering 129: 285-290.
- Ternes, T. A.; Stumpf, M.; Mueller, J.; Haberer, K.; Willken, R. D.; and Servos, M. 1999a. Behaviour and occurrence of estrogens in municipal sewage treatment plants-I. investigations in Germany, Canada and Brazil. Science of the Total Environment 225: 81-90.

- Ternes, T. A.; Kreckel, P.; and Mueller, J. 1999b. Behaviour and occurrence of estrogens in municipal sewage treatment plants-II. aerobic batch experiments with activated sludge. Science of the Total Environment 225: 91-99.
- Ternes, T. A.; Herrmann, N.; Bonerz, M.; Knacker, T.; Siegrist, H.; Joss, A. 2004. A rapid method to measure the solid-water distribution coefficient ( $K_d$ ) for pharmaceuticals and musk fragrances in sewage sludge. Water Research 38: 4075-4084.
- Vader, J. S.; Finkel, C. G.; Sperling, F. M. G. M.; Jong, J.; Boer, W.; Graaf, J. S.; Most, M.; and Stokman, P. G. W. 2000. Degradation of ethinylestradiol by nitrifying activated sludge. Chemosphere 41: 1239-1243.
- Water Environment Federation (WEF). 1998. Integrated Biological Processes for Nutrient Control in Design of Municipal Wastewater Treatment Plants. 4<sup>th</sup> ed. Virginia: WEF.
- Wentzel, M. C.; Loewenthal, R. E.; Ekama, G. A.; and Marais, G. V. 1988. Enhanced polyphosphate organism cultures in activated sludge systems I. enhanced culture development. Water SA 14: 81-92.
- Wentzel, M. C. and Ekama, G. A. 1997. Principles in the design of single-sludge activated-sludge systems for biological removal of carbon, nitrogen, and phosphorus. Water Environment Research 69: 1222-1231.
- Yu, Z. and Huang, W. 2005. Competitive sorption between 17 $\alpha$ -ethinylestradiol and naphthalene/phenanthrene by sediments. Environmental Science and Technology 39: 4878-4885.
- Zeng, R. J.; Lemaire, R.; Yuan, Z.; Keller, J. 2003a. Simultaneous nitrification, denitrification, and phosphorus removal in a lab-scale sequencing batch reactor. Biotechnology Bioengineering 84: 170-178.
- Zeng, R. J.; Saunders, A. M.; Yuan, Z.; Blackall, L. L.; and Keller J. 2003b. Identification and comparison of aerobic and denitrifying polyphosphate-accumulating organisms. Biotechnology Bioengineering 83: 140-148.
- Zhu, S. and Chen, S. 2001. Effects of organic carbon on nitrification rate in fixed film biofilters. Aquacultural Engineering 25: 1-11.

## APPENDIX A

**Phosphorus Measurement with the depth**

CD=24 HRT=6		Anaerobic											
14/5/08,	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%,	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	70.0	24.0
2.8 L/min	5 (top)	6.88	21.4	-44.6	0.32	19.6	12.2	19.8	4.6	0.160	65.00	NA	NA
	4	6.87	21.4	-47.0	0.32	20.8	12.0	20.5	4.6	0.216	50.00	NA	NA
	3	6.95	21.3	-50.9	0.29	20.6	11.8	20.9	3.3	0.112	67.50	NA	NA
	2	7.11	20.9	-70.4	0.25	20.9	11.1	21.1	3.3	0.009	132.50	NA	NA
	1	7.35	20.9	-137.0	0.16	21.7	10.9	21.3	1.0	0.079	215.00	NA	NA
	inf.	6.74	21.6	88.0	0.31	28.0	7.9	24.9	3.4	0.120	330.00	20.0	3.3
<b>Aerobic</b>	eff.	7.79	21.0	NA	NA	9.2	1.0	0.5	5.9	NA	22.50	62.0	48.0
	5 (top)	7.99	20.3	229.10	3.1	8.8	0.8	0.5	5.6	0.010	22.50	NA	NA
	4	8.18	20.5	248.00	3.2	10.2	1.0	0.5	5.6	0.003	40.00	NA	NA
	3	7.94	20.5	255.00	3.3	9.5	1.0	0.3	5.9	0.012	45.00	NA	NA
	2	7.9	20.2	260.30	3.5	9.9	1.7	0.3	5.2	0.058	50.00	NA	NA
	1	7.88	20.2	261.80	3.1	8.1	2.7	0.5	6.3	0.043	32.50	NA	NA

CD=24 HRT=4		Anaerobic											
29/5/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	20.0	16.0
3.0 L/min	5 (top)	7.11	23.0	-42.1	0.21	24.4	9.8	22.5	1.6	0.002	137.50	NA	NA
	4	7.04	23.2	-99.9	0.19	24.2	9.5	23.0	1.3	0.001	142.50	NA	NA
	3	7.05	23.1	-120.0	0.14	24.9	9.4	23.2	2.2	0.005	215.00	NA	NA
	2	7.03	23.5	-139.1	0.13	24.6	9.0	23.5	2.5	ur	230.00	NA	NA
	1	6.96	23.3	-156.2	0.13	23.2	8.5	24.2	3.2	0.012	245.00	NA	NA
	inf.	7.02	22.9	35.0	0.28	28.3	8.0	23.2	3.0	0.002	332.50	25.0	3.3
Aerobic	eff.	7.91	22.7	NA	NA	15.5	3.9	0.6	7.7	NA	12.50	8.0	8.0
	5 (top)	7.88	22.6	229.10	3.2	14.6	4.1	0.8	7.6	0.017	15.00	NA	NA
	4	7.89	22.3	248.00	3.3	15.9	5.0	1.2	7.5	0.011	17.50	NA	NA
	3	7.81	22.3	255.00	3.2	16.5	5.8	1.1	8.9	0.052	30.00	NA	NA
	2	7.79	22.4	260.30	3.1	17.0	5.9	0.9	8.6	0.210	52.50	NA	NA
	1	7.75	22.8	261.80	3.1	19.3	6.5	3.2	8.7	0.190	67.50	NA	NA



CD=12 HRT=6

		Anaerobic											
18/3/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	7.28	22.1	NA	NA	22.5	12.4	18.6	3.3	NA	65.0	63.3	26.7
3.0 L/min	5 (top)	7.45	22.4	-78.50	0.55	23.0	13.4	21.8	2.0	0.006	57.5	NA	NA
	4	7.36	22.2	-81.80	0.50	23.8	15.5	22.7	2.7	0.008	82.5	NA	NA
	3	7.27	21.0	-85.90	0.45	24.2	16.4	21.3	3.0	0.005	107.5	NA	NA
	2	7.28	20.4	-118.50	0.44	24.2	15.9	21.2	4.9	0.005	135.0	NA	NA
	1	7.14	21.0	-120.00	0.44	25.9	14.9	22.4	4.8	0.018	155.0	NA	NA
	inf.	6.77	21.0	136.00	0.90	28.0	8.6	22.0	3.2	0.011	320.0	33.3	6.7

		Aerobic											
	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
	eff.	8.00	22.0	NA	NA	15.1	1.8	ur	8.2	NA	12.5	6.7	0.0
	5 (top)	8.15	21.7	297.80	4.1	15.1	1.6	0.1	9.6	0.027	15.0	NA	NA
	4	8.25	21.1	260.10	3.9	15.7	2.2	ur	10.2	0.042	17.5	NA	NA
	3	8.22	20.9	293.00	4.0	16.4	3.0	0.1	7.1	0.022	20.0	NA	NA
	2	8.23	21.6	306.10	4.1	16.9	4.3	ur	7.6	0.011	55.0	NA	NA
	1	7.86	21.4	311.30	4.1	18.8	6.5	0.4	8.5	0.113	60.0	NA	NA

**CD=12 HRT=4**

		<b>Anaerobic</b>											
<i>29/3/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	28.0	16.0
3.0 L/min	<i>5 (top)</i>	7.33	21.1	1.40	0.31	19.3	10.8	17.3	1.2	0.003	82.5	NA	NA
	<i>4</i>	7.30	21.4	-15.50	0.29	23.5	11.1	19.4	1.0	0.006	105.0	NA	NA
	<i>3</i>	7.34	21.4	-82.40	0.29	21.8	10.5	19.4	1.6	0.002	120.0	NA	NA
	<i>2</i>	7.35	20.4	-114.50	0.18	21.1	8.8	19.2	1.6	0.009	147.5	NA	NA
	<i>1</i>	7.19	20.8	-124.30	0.17	20.8	8.2	18.7	1.8	0.012	210.0	NA	NA
	<i>inf.</i>	6.89	20.8	-98.00	0.28	25.4	7.6	19.9	4.1	0.017	339.0	20.0	0.0

		<b>Aerobic</b>											
<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>	
<i>eff.</i>	8.14	22.0	NA	NA	13.0	1.4	0.3	9.2	NA	27.5	8.0	0.0	
<i>5 (top)</i>	8.21	21.0	252.80	5.2	13.6	1.4	0.6	6.8	0.300	30.0	NA	NA	
<i>4</i>	8.20	21.0	267.80	5.1	13.0	1.7	ur	9.0	0.011	42.5	NA	NA	
<i>3</i>	8.26	21.3	271.60	5.1	14.5	3.1	ur	9.1	0.014	65.0	NA	NA	
<i>2</i>	8.01	21.7	279.90	5.2	14.5	4.8	0.4	10.8	0.014	67.5	NA	NA	
<i>1</i>	7.59	21.1	285.90	5.2	14.1	5.1	1.5	8.9	0.300	67.5	NA	NA	

CD=12 HRT=3

Anaerobic

9/4/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	73.3	26.7
3.0 L/min	5 (top)	7	21.4	-96.0	0.17	21.9	10.4	21.4	2.8	0.008	100.00	NA	NA
	4	7.06	21.4	-105.0	0.13	23.4	9.6	22.5	3.1	0.006	165.00	NA	NA
	3	7.07	20.8	-105.6	0.13	22.9	9.7	22.7	3.2	0.005	190.00	NA	NA
	2	6.90	21.0	-96.0	0.16	22.9	9.1	22.7	3.0	0.020	197.50	NA	NA
	1	6.97	20.5	-104.1	0.13	24.7	9.3	23.2	3.3	0.025	220.00	NA	NA
	inf.	6.90	20.3	72.9	0.34	25.9	7.8	25.1	3.0	0.006	302.50	20.0	3.3

Aerobic

Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
eff.	7.79	20.3	NA	NA	19.1	6.3	1.2	10.6	NA	15.00	25.0	3.3
5 (top)	7.59	20.3	237.50	3.6	19.5	7.0	3.0	10.6	0.010	5.00	NA	NA
4	7.6	20.0	220.10	3.6	17.5	8.0	11.3	4.6	0.011	7.50	NA	NA
3	7.72	20.5	247.30	3.7	19.7	8.5	16.4	2.8	0.028	17.50	NA	NA
2	7.64	20.5	225.20	3.6	20.2	9.5	19.5	2.2	0.044	150.00	NA	NA
1	7.58	20.7	212.00	3.5	19.9	9.8	19.9	1.9	0.010	125.00	NA	NA

CD=12 HRT=2

Anaerobic

21/4/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	70.7	33.3
3.0 L/min	5 (top)	7.17	20.7	-104.3	0.23	24.1	11.6	17.9	4.6	0.025	107.50	NA	NA
	4	7.25	21.7	-118.2	0.23	24.2	10.4	18.1	5.6	0.024	142.50	NA	NA
	3	7.15	21.2	-132.2	0.23	24.4	9.6	18.3	6.4	0.022	190.00	NA	NA
	2	6.98	21.2	-128.5	0.21	24.2	10.3	18.0	7.0	0.021	205.00	NA	NA
	1	6.94	21.3	-139.5	0.20	24.2	10.5	18.0	7.2	0.022	240.00	NA	NA
	inf.	6.78	20.3	85.0	0.32	25.1	7.6	19.1	5.9	0.036	330.00	33.3	6.7

Aerobic

Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
eff.	7.95	22.0	NA	NA	23.0	7.2	5.0	11.0	NA	12.50	22.5	3.3
5 (top)	7.85	21.3	200.8	2.3	22.4	8.0	5.0	10.3	0.200	15.00	NA	NA
4	8.06	22.9	205.4	3.8	23.0	8.2	5.2	10.0	0.200	32.50	NA	NA
3	7.55	21.9	206.4	3.0	16.8	8.3	5.2	9.9	0.200	42.50	NA	NA
2	7.56	22.1	227.0	3.0	22.0	9.0	8.0	12.2	0.200	87.50	NA	NA
1	7.57	21.9	218.5	3.0	21.1	9.1	ur	13.5	0.200	100.00	NA	NA

**CD=6 HRT=6**

		<b>Anaerobic</b>											
<i>19/06/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	14.0	0.0
3.0 L/min	<i>5 (top)</i>	7.09	22.8	150.1	1.75	18.5	9.7	3.3	7.6	0.013	35.00	NA	NA
	<i>4</i>	7.05	22.2	115.1	1.10	18.9	9.3	7.2	7.2	0.020	40.00	NA	NA
	<i>3</i>	7.13	22.5	106.8	0.90	17.5	8.6	10.7	5.6	0.129	42.50	NA	NA
	<i>2</i>	7.29	22.5	59.8	0.65	19.7	8.3	15.0	3.3	0.030	90.00	NA	NA
	<i>1</i>	7.37	22.6	-197.4	0.01	25.0	9.2	19.2	2.1	0.081	120.00	NA	NA
	<i>inf.</i>	6.80	23.2	23.0	0.31	27.2	8.4	23.2	3.0	0.023	305.00	25.0	3.3

		<b>Aerobic</b>											
	<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
	<i>eff.</i>	8.18	22.6	NA	NA	8.7	1.6	0.2	7.3	NA	2.50	12.0	4.0
	<i>5 (top)</i>	8.23	22.6	202.13	2.7	8.6	1.6	0.2	7.1	0.006	2.50	NA	NA
	<i>4</i>	8.2	22.8	201.30	2.7	8.6	1.2	0.3	7.0	0.183	15.00	NA	NA
	<i>3</i>	8.05	23.0	198.34	2.6	8.2	1.8	0.4	6.1	0.017	17.50	NA	NA
	<i>2</i>	8.02	23.1	203.80	2.7	7.5	2.5	0.4	5.6	0.200	25.00	NA	NA
	<i>1</i>	7.96	23.1	210.89	2.8	6.3	3.2	0.4	5.3	0.018	42.50	NA	NA

CD=6 HRT=4

Anaerobic

3/7/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	22.5	3.3
3.0 L/min	5 (top)	7.41	22.6	-25.6	0.54	21.4	13.4	19.1	1.6	0.024	70.00	NA	NA
	4	7.40	22.6	-42.3	0.44	24.9	13.8	19.8	2.1	0.014	80.00	NA	NA
	3	7.29	22.6	-78.9	0.12	24.0	13.5	19.3	2.4	0.016	95.00	NA	NA
	2	7.15	22.4	-88.9	0.09	27.4	11.7	18.8	2.8	0.022	125.00	NA	NA
	1	6.98	22.6	-120.0	0.05	27.5	10.0	21.5	5.1	0.054	177.50	NA	NA
	inf.	7.17	22.8	25.8	0.35	28.2	8.1	24.2	4.1	0.021	370.00	20.0	0.0

Aerobic

Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
eff.	7.92	22.9	NA	NA	9.9	1.3	0.4	6.3	NA	20.00	8.0	0.0
5 (top)	7.92	22.8	240.01	3.8	9.3	1.4	0.5	6.1	0.006	22.50	NA	NA
4	8.07	22.6	262.10	4.2	8.7	1.5	ur	6.2	0.003	20.00	NA	NA
3	8.14	22.9	225.91	3.5	9.5	1.3	ur	4.9	0.008	12.50	NA	NA
2	7.97	22.7	249.80	4.0	8.4	1.5	0.2	5.5	0.022	27.50	NA	NA
1	7.75	22.9	237.40	3.4	10.4	3.3	4.1	3.3	0.312	25.00	NA	NA

**CD=6 HRT=3**

		<b>Anaerobic</b>											
<i>11/7/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	33.3	6.7
3.0 L/min	<i>5 (top)</i>	7.27	21.8	-64.1	0.11	21.9	13.3	21.4	2.4	0.011	105.00	NA	NA
	<i>4</i>	7.25	21.6	-75.3	0.12	22.7	13.3	19.8	4.2	0.001	110.00	NA	NA
	<i>3</i>	7.20	21.5	-82.0	0.12	23.2	12.5	19.5	4.4	0.002	137.50	NA	NA
	<i>2</i>	7.13	21.4	-122.0	0.11	23.8	10.3	19.9	4.9	0.006	185.00	NA	NA
	<i>1</i>	7.30	21.4	-130.3	0.10	24.6	8.8	18.9	6.3	0.004	235.00	NA	NA
	<i>inf.</i>	6.85	21.5	42.2	0.31	27.8	7.5	19.7	4.1	0.019	352.50	22.5	3.3
		<b>Aerobic</b>											
	<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
	<i>eff.</i>	7.94	21.7	NA	NA	10.2	1.9	ur	7.0	NA	20.00	12.0	4.0
	<i>5 (top)</i>	7.92	21.5	226.20	3.0	10.4	1.9	ur	7.2	0.015	22.50	NA	NA
	<i>4</i>	8.17	21.5	220.00	3.0	10.4	2.5	ur	6.5	0.043	20.00	NA	NA
	<i>3</i>	8.16	21.5	223.24	3.5	11.1	3.3	0.1	5.4	0.145	12.50	NA	NA
	<i>2</i>	7.84	21.6	220.00	3.0	11.6	3.7	0.3	7.2	0.300	27.50	NA	NA
	<i>1</i>	7.54	21.5	220.00	2.9	12.5	4.0	4.2	6.6	0.067	25.00	NA	NA

CD=3 HRT=3

Anaerobic

31/7/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	8.0	6.0
3.0 L/min	5 (top)	7.29	20.0	-70.2	0.18	22.8	11.9	15.1	1.8	0.026	67.50	NA	NA
	4	7.25	19.9	-70.0	0.17	22.9	11.1	17.0	1.5	0.024	70.00	NA	NA
	3	7.24	19.9	-101.5	0.12	23.9	11.0	17.8	1.7	0.012	72.50	NA	NA
	2	7.20	20.1	-122.5	0.07	24.1	8.9	20.0	0.3	0.002	80.00	NA	NA
	1	7.17	20.2	-153.4	0.02	25.1	8.6	20.8	1.7	0.005	112.50	NA	NA
	inf.	6.97	21.5	-31.1	0.20	27.5	8.0	21.9	2.9	0.003	325.00	20.0	0.0

Aerobic

Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
eff.	7.91	20.5	NA	NA	7.8	1.1	0.3	8.6	NA	10.00	4.0	6.0
5 (top)	7.85	20.7	303.31	3.1	7.7	1.1	0.3	8.7	0.014	10.00	NA	NA
4	7.93	20.5	332.24	3.3	8.0	1.3	0.4	8.5	0.026	15.00	NA	NA
3	8.04	20.4	335.12	3.3	8.9	1.9	0.5	8.1	0.015	15.00	NA	NA
2	7.99	20.1	301.52	3.1	10.5	3.5	1.1	7.8	0.009	30.00	NA	NA
1	7.97	20.5	312.90	3.2	12.1	4.0	3.9	6.0	0.025	40.00	NA	NA



CD=3 HRT=2

		Anaerobic											
11/8/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air 100%	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	14.0	3.3
3.0 L/min	5 (top)	7.32	21.3	-50.1	0.21	24.0	12.5	17.9	2.2	0.021	117.50	NA	NA
	4	7.25	21.0	-59.2	0.19	24.3	12.3	18.3	1.9	0.022	120.00	NA	NA
	3	7.24	21.2	-87.5	0.15	24.9	11.1	19.1	1.0	0.012	125.00	NA	NA
	2	7.21	21.5	-118.9	0.07	25.9	10.4	21.1	1.2	0.009	140.00	NA	NA
	1	7.13	21.4	-129.1	0.03	26.0	9.6	22.0	1.5	0.004	150.00	NA	NA
	inf.	6.91	21.3	-32.2	0.21	26.9	8.1	23.5	2.4	0.001	325.00	25.0	3.3
		Aerobic											
	Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
	eff.	8.01	21.0	NA	NA	9.5	1.7	0.5	8.0	NA	35.00	12.0	4.0
	5 (top)	7.93	21.1	325.81	3.2	10.5	1.8	0.7	8.1	0.015	40.00	NA	NA
	4	7.89	21.0	312.24	3.1	11.0	1.9	0.7	7.6	0.021	45.00	NA	NA
	3	7.91	20.7	315.54	3.1	11.5	2.2	1.0	7.9	0.003	45.00	NA	NA
	2	7.88	20.6	311.52	3.1	12.0	4.1	1.5	7.1	0.042	55.00	NA	NA
	1	7.81	21.1	321.47	3.2	12.1	5.3	5.3	5.2	0.032	70.00	NA	NA

**Air:Water=0.048**

**Anaerobic**

21/7/08	Port	pH	Temp.(°C)	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
air	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	14.0	3.3
2.0 L/min	5 (top)	7.41	21.3	-41.3	0.25	22.0	12.7	18.4	4.0	0.300	65.00	NA	NA
	4	7.4	21.5	-79.0	0.12	23.4	12.5	19.0	3.5	0.212	67.50	NA	NA
	3	7.40	21.7	-87.9	0.15	24.5	12.1	20.0	1.8	0.258	72.50	NA	NA
	2	7.22	21.5	-154.1	0.07	25.0	10.5	20.1	2.2	0.052	92.50	NA	NA
	1	7.15	21.6	-163.2	0.05	25.1	9.5	20.1	2.6	0.028	140.00	NA	NA
	inf.	6.84	21.5	15.0	0.29	28.1	8.2	21.5	4.2	0.020	322.50	25.0	3.3

**Aerobic**

Port	pH	Temp.	ORP	DO	TN	TP	NH4-N	NO3-N	NO2-N	COD	SS	VSS
eff.	8.47	21.5	NA	NA	9.3	2.0	0.3	7.9	NA	7.50	12.0	4.0
5 (top)	8.45	21.3	173.70	2.0	9.5	2.2	0.3	7.8	0.041	7.50	NA	NA
4	8.33	21.1	189.90	2.2	9.8	2.9	0.5	7.4	0.210	10.00	NA	NA
3	8.3	21.1	184.23	2.2	10.1	3.6	0.4	7.2	0.026	10.00	NA	NA
2	8.01	21.1	197.24	2.1	10.5	4.1	1.9	6.9	0.018	15.00	NA	NA
1	7.65	20.8	200.80	2.4	10.7	9.2	4.1	5.2	0.300	25.00	NA	NA

**Air:Water=0.024**

		<b>Anaerobic</b>											
<b>23/7/08</b>	<b>Port</b>	<b>pH</b>	<b>Temp.(°C)</b>	<b>ORP</b>	<b>DO</b>	<b>TN</b>	<b>TP</b>	<b>NH4-N</b>	<b>NO3-N</b>	<b>NO2-N</b>	<b>COD</b>	<b>SS</b>	<b>VSS</b>
air	eff.	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	33.3	6.7
1.0 L/min	5 (top)	7.6	19.1	49.0	0.27	23.9	12.4	17.6	0.2	0.003	107.50	NA	NA
	4	7.55	19.4	-10.3	0.20	24.0	12.5	18.1	1.0	0.002	125.00	NA	NA
	3	7.49	19.3	-113.8	0.11	24.6	12.9	18.6	1.1	0.004	182.50	NA	NA
	2	7.32	19.4	-121.6	0.07	26.0	11.1	22.1	2.1	0.009	192.50	NA	NA
	1	7.22	19.2	-141.3	0.03	27.4	10.0	22.3	2.7	0.011	212.50	NA	NA
	inf.	7.55	20.1	17.1	0.29	28.0	7.6	23.6	3.2	0.025	342.50	20.0	0.0

		<b>Aerobic</b>											
	<b>Port</b>	<b>pH</b>	<b>Temp.</b>	<b>ORP</b>	<b>DO</b>	<b>TN</b>	<b>TP</b>	<b>NH4-N</b>	<b>NO3-N</b>	<b>NO2-N</b>	<b>COD</b>	<b>SS</b>	<b>VSS</b>
	eff.	7.90	20.0	NA	NA	9.7	2.4	0.1	6.5	NA	57.50	22.5	3.3
	5 (top)	7.86	19.8	131.60	1.3	9.7	2.4	0.1	6.3	0.328	57.50	NA	NA
	4	7.85	20.2	132.00	1.3	9.7	2.5	0.3	6.0	0.300	65.00	NA	NA
	3	7.94	20.1	126.40	1.2	9.8	2.7	0.6	6.0	0.006	65.00	NA	NA
	2	7.85	20.2	128.00	1.2	10.0	2.8	3.5	5.1	0.210	62.50	NA	NA
	1	7.81	20.4	128.20	1.2	10.6	2.8	5.4	2.5	0.008	75.00	NA	NA

**COD:N=16**

		<b>Anaerobic</b>											
<i>2/8/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	8.0	4.0
3.0 L/min	<i>5 (top)</i>	7.16	22.1	-75.2	0.18	15.6	11.9	12.6	0.4	0.005	25.00	NA	NA
	<i>4</i>	7.15	22.0	-80.9	0.16	16.4	12.0	12.9	1.2	0.011	27.50	NA	NA
	<i>3</i>	7.12	21.3	-118.6	0.09	17.4	12.4	13.9	0.9	0.025	40.00	NA	NA
	<i>2</i>	7.10	21.5	-118.1	0.08	18.4	11.9	14.8	1.0	0.007	42.50	NA	NA
	<i>1</i>	6.93	21.2	-158.2	0.02	19.1	11.5	14.9	0.3	0.008	50.00	NA	NA
	<i>inf.</i>	6.66	22.1	-99.2	0.17	21.8	7.7	17.0	2.9	0.024	332.50	22.5	3.3

		<b>Aerobic</b>											
	<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
	<i>eff.</i>	7.75	22.4	NA	NA	6.0	2.6	0.2	5.0	NA	0.00	6.0	6.0
	<i>5 (top)</i>	7.68	22.3	321.90	2.9	6.1	2.6	0.3	5.7	0.009	0.00	NA	NA
	<i>4</i>	7.83	22.1	329.25	3.2	5.8	3.1	0.5	5.2	0.016	5.00	NA	NA
	<i>3</i>	8	22.3	335.40	3.3	5.7	5.1	0.5	5.0	0.007	2.50	NA	NA
	<i>2</i>	7.93	22.2	328.53	3.1	6.0	4.9	1.0	4.9	0.029	5.00	NA	NA
	<i>1</i>	7.91	22.5	329.10	3.0	8.5	6.3	2.9	1.6	0.300	17.50	NA	NA

**COD:N=8**

		<b>Anaerobic</b>											
<i>8/8/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	8.0	6.0
3.0 L/min	<i>5 (top)</i>	7.24	22.6	-29.1	0.40	31.2	15.1	29.0	2.1	0.022	30.00	NA	NA
	<i>4</i>	7.2	22.5	-35.9	0.35	31.9	15.0	31.0	1.0	0.012	47.50	NA	NA
	<i>3</i>	7.19	22.3	-125.1	0.14	34.4	14.0	31.3	1.3	0.006	52.50	NA	NA
	<i>42</i>	7.14	22.3	-132.5	0.09	35.6	12.5	32.7	0.3	0.005	120.00	NA	NA
	<i>1</i>	6.90	22.7	-151.7	0.01	39.9	9.9	34.4	0.8	0.011	177.50	NA	NA
	<i>inf.</i>	6.67	22.5	-100.7	0.17	43.0	7.5	36.9	2.8	0.046	345.00	20.0	0.0

		<b>Aerobic</b>											
	<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>
	<i>eff.</i>	8.10	22.7	NA	NA	17.2	1.1	0.2	13.0	NA	0.00	4.0	6.0
	<i>5 (top)</i>	8	22.6	292.56	2.8	17.1	1.1	0.2	12.9	0.120	0.00	NA	NA
	<i>4</i>	7.95	21.9	322.11	3.3	17.4	1.1	0.4	12.5	0.130	0.00	NA	NA
	<i>3</i>	7.9	22.0	320.91	3.0	17.4	1.2	0.6	12.5	0.300	0.00	NA	NA
	<i>2</i>	7.9	22.1	310.68	3.2	17.8	1.3	1.0	10.4	0.214	5.00	NA	NA
	<i>1</i>	7.89	21.6	321.57	3.2	18.0	1.4	9.5	5.1	0.300	5.00	NA	NA

**COD:P=60**

		<b>Anaerobic</b>												
<i>16/8/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>	
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	33.3	6.7	
3.0 L/min	<i>5 (top)</i>	7.25	24.7	-41.5	0.20	23.2	18.0	25.0	3.4	0.059	60.00	NA	NA	
	<i>4</i>	7.14	24.5	-72.0	0.15	25.0	17.5	25.0	1.1	0.015	77.50	NA	NA	
	<i>3</i>	7.02	24.8	-94.6	0.09	25.2	17.0	25.4	0.8	0.005	120.00	NA	NA	
	<i>2</i>	6.95	24.3	-113.5	0.02	25.9	15.0	26.9	1.1	0.029	180.00	NA	NA	
	<i>1</i>	6.88	25.0	-139.1	0.01	27.3	13.2	27.4	0.5	0.009	215.00	NA	NA	
	<i>inf.</i>	6.82	24.7	-13.7	0.20	28.5	8.0	28.0	2.8	0.012	455.00	20.0	0.0	

		<b>Aerobic</b>												
	<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>	
	<i>eff.</i>	7.97	24.7	NA	NA	12.5	0.6	0.1	9.1	NA	0.00	22.5	3.3	
	<i>5 (top)</i>	7.95	24.5	355.91	3.7	12.7	0.6	0.1	9.2	0.017	0.00	NA	NA	
	<i>4</i>	7.81	24.0	323.27	3.5	12.0	0.8	0.9	8.7	0.053	5.00	NA	NA	
	<i>3</i>	7.74	23.4	320.40	3.3	10.4	1.0	5.4	8.9	0.300	12.50	NA	NA	
	<i>2</i>	7.58	24.0	324.06	3.3	13.9	4.1	9.2	8.8	0.190	20.00	NA	NA	
	<i>1</i>	7.33	24.1	300.74	2.8	15.2	6.5	13.4	8.4	0.196	32.50	NA	NA	

**COD:P=30**

		<b>Anaerobic</b>												
<i>22/8/08</i>	<i>Port</i>	<i>pH</i>	<i>Temp.(°C)</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>	
air 100%	<i>eff.</i>	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	14.0	3.3	
3.0 L/min	<i>5 (top)</i>	7.12	24.5	45.1	0.39	24.0	19.2	22.8	4.2	0.036	25.00	NA	NA	
	<i>4</i>	7.1	22.9	-73.1	0.11	24.9	18.9	23.1	3.0	0.012	32.50	NA	NA	
	<i>3</i>	6.99	23.2	-71.9	0.07	25.1	19.0	23.9	1.8	0.026	42.50	NA	NA	
	<i>2</i>	7.07	23.1	-93.1	0.05	25.8	18.3	24.1	0.8	0.019	72.50	NA	NA	
	<i>1</i>	7.05	23.2	-101.0	0.05	27.2	15.6	24.4	0.8	0.023	95.00	NA	NA	
	<i>inf.</i>	7.00	22.9	-32.7	0.20	28.5	8.7	25.1	2.0	0.024	230.00	25.0	3.3	

		<b>Aerobic</b>												
<i>Port</i>	<i>pH</i>	<i>Temp.</i>	<i>ORP</i>	<i>DO</i>	<i>TN</i>	<i>TP</i>	<i>NH4-N</i>	<i>NO3-N</i>	<i>NO2-N</i>	<i>COD</i>	<i>SS</i>	<i>VSS</i>		
<i>eff.</i>	7.45	24.3	NA	NA	15.3	0.3	0.0	11.8	NA	0.00	12.0	4.0		
<i>5 (top)</i>	7.47	24.3	342.48	3.5	15.1	0.3	0.2	11.7	0.005	0.00	NA	NA		
<i>4</i>	7.5	24.1	321.39	3.1	14.9	0.5	3.5	10.6	0.001	2.50	NA	NA		
<i>3</i>	7.53	24.6	279.55	2.5	13.6	0.8	7.5	10.8	0.018	7.50	NA	NA		
<i>2</i>	7.5	24.9	200.53	1.9	15.5	3.5	7.9	10.4	0.023	12.50	NA	NA		
<i>1</i>	7.45	24.8	125.81	1.0	17.5	4.2	14.3	10.1	0.021	17.50	NA	NA		


**APPENDIX B**




### E2 and E1 calibration curve

Calibration curves for E2 and E1 were prepared by plotting the response peak area of E2 and E1 versus the E2 and E1 standard concentrations (see below). The limits of the detection (LOD) for E2 was 3 ug/L and E1 was 3 ug/L.

E2 Calibration Curve

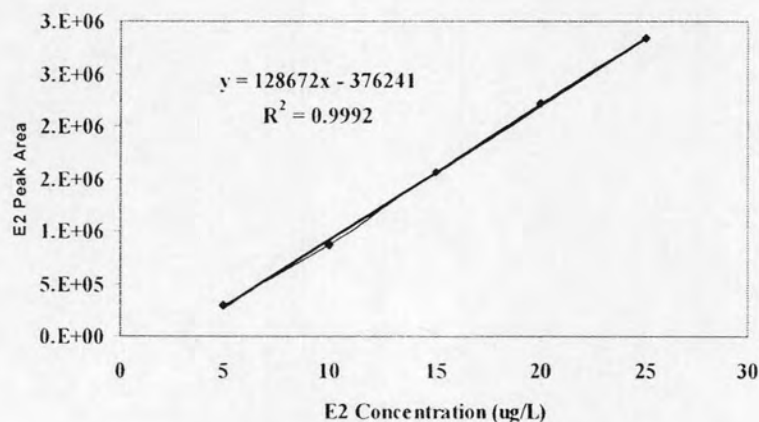

E1 Calibration Curve

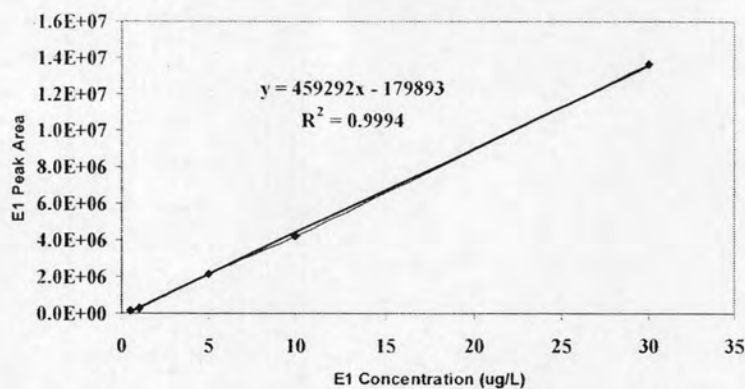

### Adsorption isotherm data

$C_0$ (ug/L)	10	50	250	500	1000
$C_{aq}^{ads}$ (ppb)	4.95	22.53	144.97	370.59	847.61
$C_s^{ads}$ (ug/g)	16.83	91.57	350.1	431.37	507.97
$\log C_{aq}^{ads}$ (ppb)	0.694605	1.352761	2.161278	2.568894	2.928196
$\log C_s^{ads}$ (ug/g)	1.226084	1.961753	2.544192	2.63485	2.705838

**APPENDIX C**

**The impact of operating parameters to E2 removal efficiency.**

<b>HRT=6</b>	E2	E1	<b>HRT=4</b>	E2	E1	<b>HRT=3</b>	E2	E1
Influent	89.19	4.05	Influent	111.7647	3.275	Influent	98.94706	3.09
1	14.07	78.192	1	79.19412	6.975	1	81.51765	10.235
3	6.09	65.452	3	51.70588	81.815	3	65	67.5475
5	4.84	42.448	5	34.06471	70.025	5	48.27647	50.945
6	4.69	2.99	6	4.84	7.83	6	43.48	12.78
8	4.77	0.22	8	3.65	0.43	8	5.17	1.13
Effluent	4.59	0.24	Effluent	3.44	0.47	Effluent	4.38	0.55

<b>Air:Water 0.072</b>	E2	E1	NO3-N	<b>Air:Water 0.048</b>	E2	E1	NO3-N	<b>Air:Water 0.024</b>	E2	E1	NO3-N
Influent	121.13	3.89	2.9	Influent	80.16	5.11	4.2	Influent	91.39	4.02	3.2
1	88.48	43.28	1.7	1	51.98	76.03	2.6	1	74.92	43.92	2.7
3	64.76	34.94	1.7	3	30.88	70.45	1.8	3	54.75	45.13	1.1
5	27.53	33.05	1.8	5	23.25	35.32	4	5	21.82	27.88	0.2
6	10.36	8.95	6	6	16.2	0.65	5.2	6	4.88	16.82	2.5
8	2.91	0.59	8.1	8	4.39	0.26	7.2	8	4.46	12.79	6
Effluent	2.69	0.57	8.6	Effluent	4.15	2.75	7.9	Effluent	4.01	12.01	6.5

<b>C/N=16</b>	E2	E1	NO3-N	<b>C/N=12</b>	E2	E1	NO3-N	<b>C/N=8</b>	E2	E1	NO3-N
Influent	104.46	9.84	2.9	Influent	121.13	3.89	2.9	Influent	110.475	2.93	2.8
1	57.81	90.02	0.3	1	88.48	43.28	1.7	1	66.47	63.29	0.8
3	33.51	73.68	0.9	3	64.76	34.94	1.7	3	29.03	51.38	1.3
5	22.34	48.82	0.4	5	27.53	33.05	1.8	5	10.62	45.06	2.1
6	3.8	1.19	1.6	6	10.36	8.95	6	6	2.305	1.105	5.1
8	2.94	0.23	5	8	2.91	0.59	8.1	8	1.975	0.17	12.5
Effluent	3.48	0.46	5	Effluent	2.69	0.57	8.6	Effluent	1.63	0.125	13

## BIOGRAPHY

Mr Sutthipong Lapanunt was born in Chonburi, Thailand in 1983. He received his Bachelor of Science degree in Environmental Science from Kasetsart University in 2006. His bachelor's degree project was entitled "Preparation of Coagulant from Sludge for Oil and Grease Treatment". The project was financially supported by Industrial and Research Projects for Undergraduate Students (IRPUS), Thailand Research Fund (TRF). It was an early research work of his life.

Soon after, he graduated with a Master's degree from the International Postgraduate Programs in Master degree in Environmental Management, Chulalongkorn University. He conducted his thesis experiments as a visiting scholar for a year at the Department of Civil, Construction and Environmental Engineering, Iowa State University, Iowa, USA. No obstacle was too great for him to overcome. He hopes this principle will keep continuing for the rest of his life and he also wishes his accomplishments would not end here.

His research interests have focused on physical, chemical, and biological treatment systems for hazardous waste and municipal and industrial wastewaters. His interests also include waste treatment plants development and recovery of valuable byproduct and energy byproducts such as methane and hydrogen.